




FOODSERVICE EQUIPMENT SCHEDULE											
ITEM NO. QTY. DESCRIPTION MANUFACTURER MODEL NO.											
2	1	SINGLE COMPARTMENT SINK	WIN HOLT	WS1T2424LD24							
18	2	HAND SINK	ADVANCE TABCO	7-PS-79							
22	1	COFFEE BREWER	BLOOMFIELD	8572							
24	1	SOIL DISHTABLE	ADVANCE TABCO	DTS-S60-60RX							
26	1	DISHWASHER	PURITAN	PA-1							
29	1	THREE COMPARTMENT SINK	ADVANCE TABCO	T9-63-54-24RLX							
37	1	SODA DISPENSER	PEPSI	PEPSI							
42	1	3'x3' CAN WASH	BUILT ON SITE	BUILT ON SITE							
45	2	TANKLESS GAS WATER HEATER	RINNAI	C85E (2432 WC)							

PIPING	LEGEND
SYMBOL	DESCRIPTION
H	140° HOT WATER
H	110° TEMPERED WATER
C —	COLD WATER
c — — — —	EXISTING COLD WATER

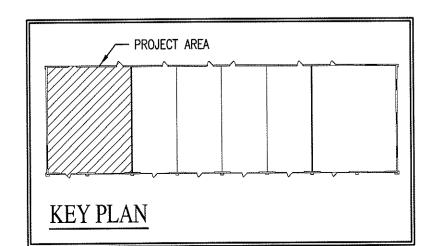

WA	LL LEGEND
SYMBOL	DESCRIPTION
	2-HOUR RATED FIRE PARTITION

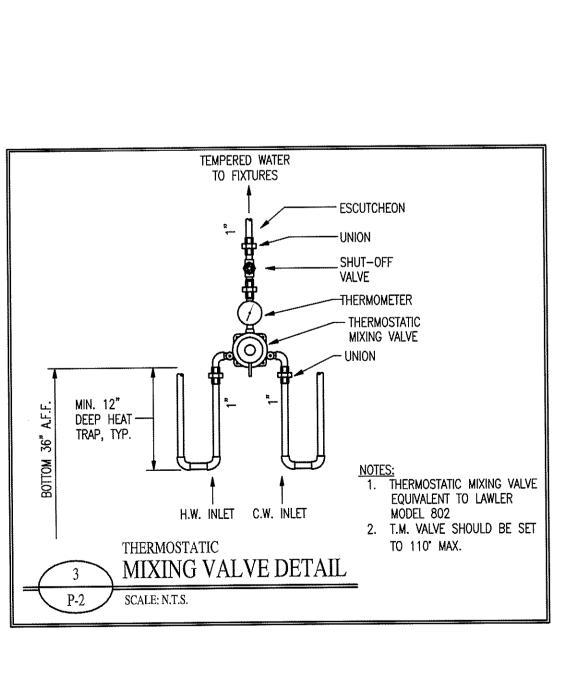

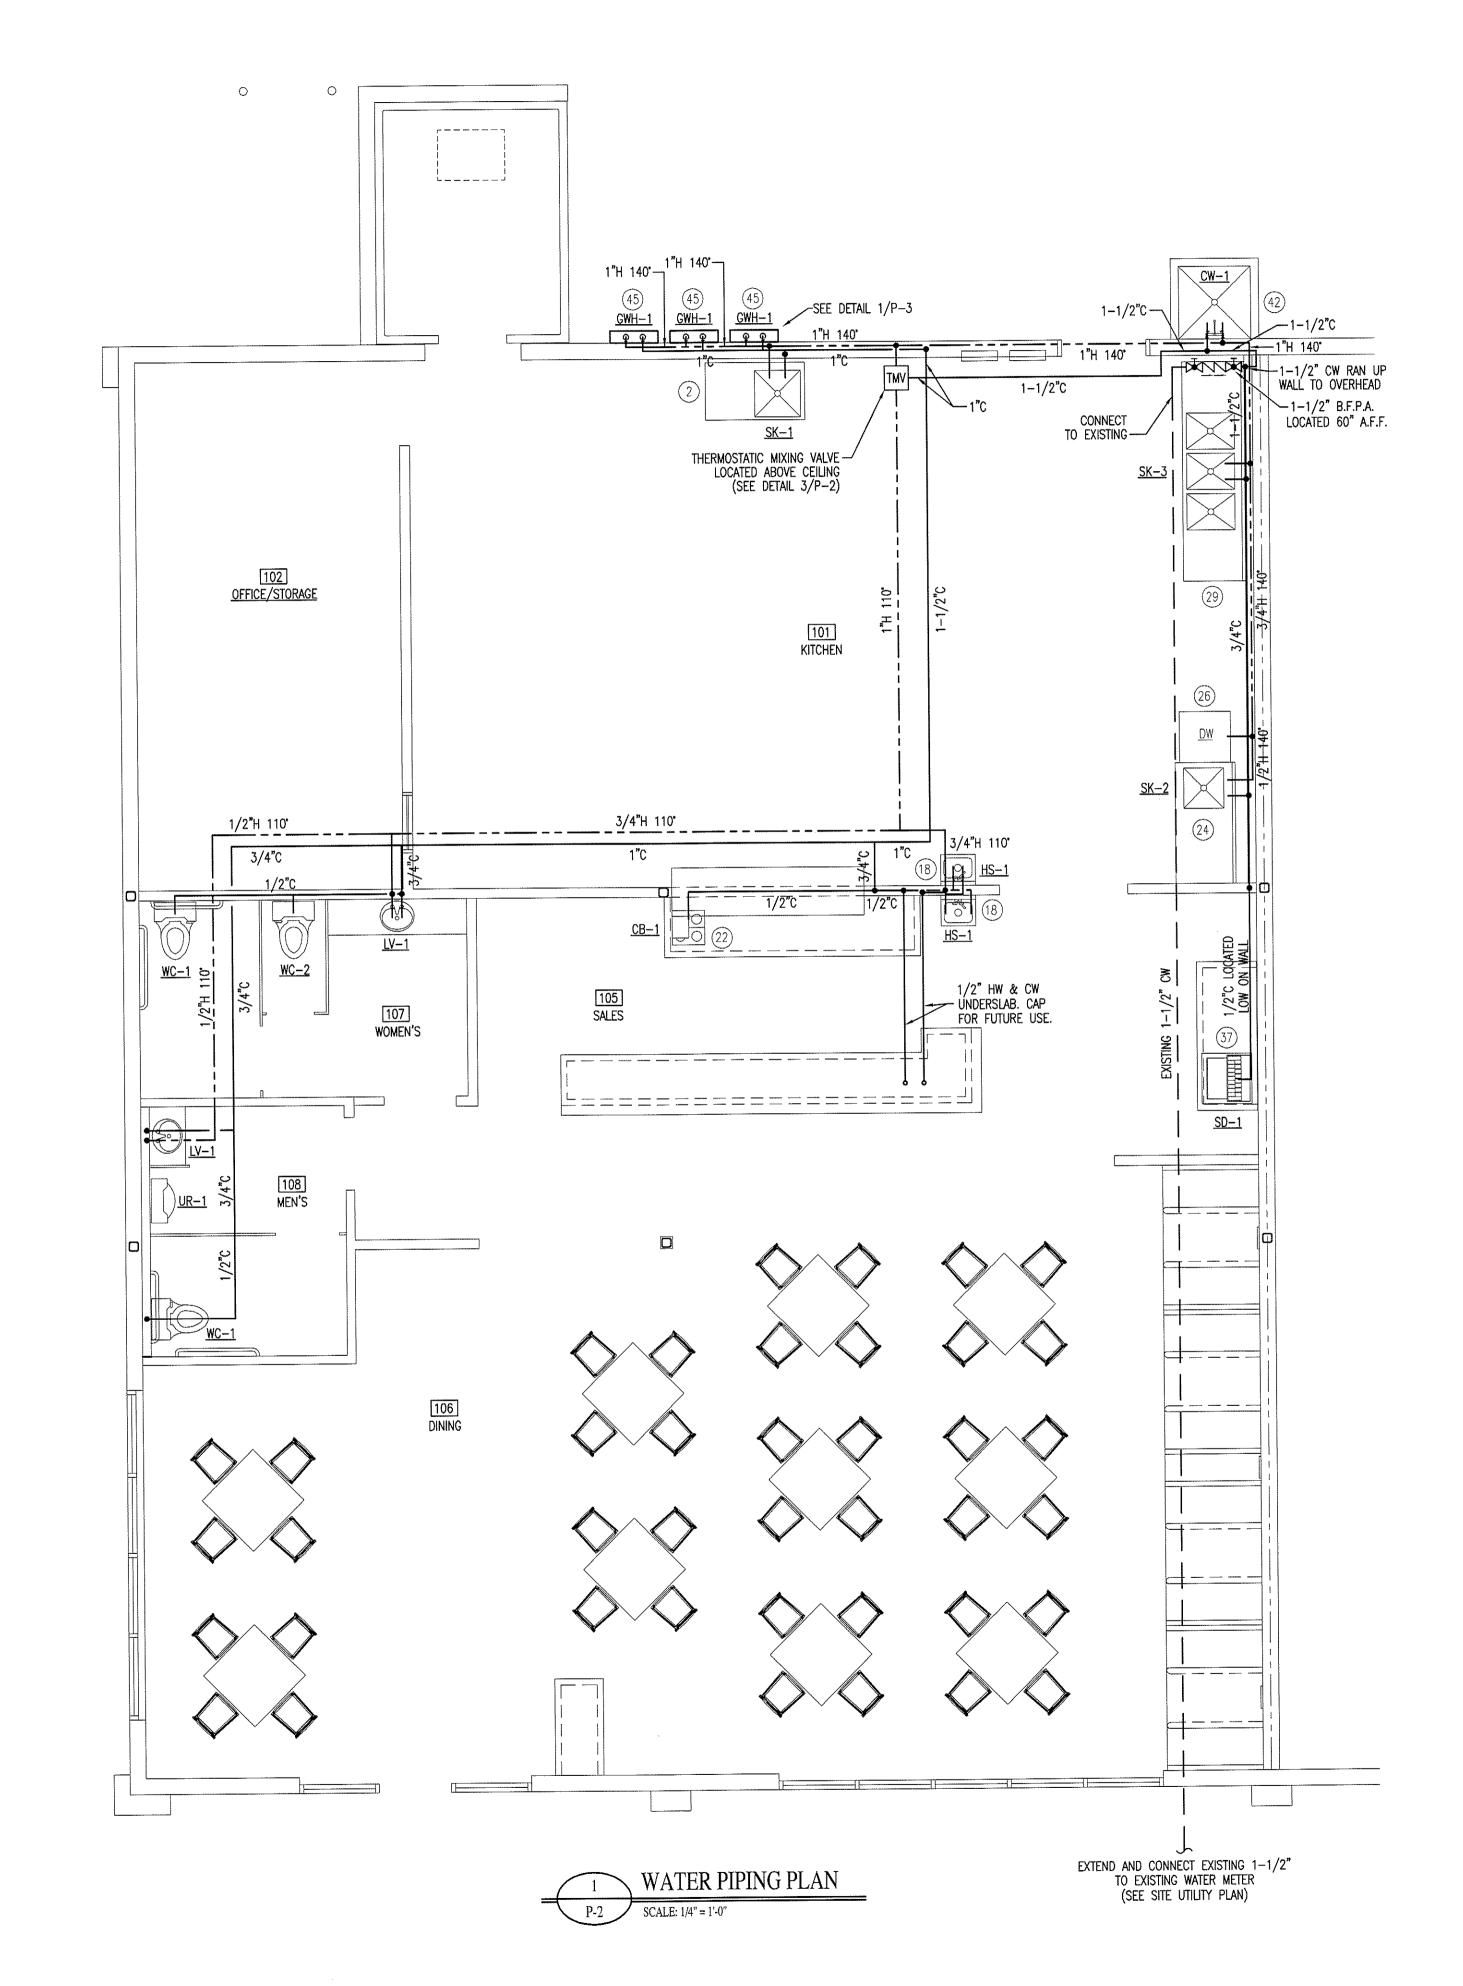

Copyright © 2008 Alamance Consulting Engineers, P.A. Ali Rights Reserved No part of these plans may be copied, reproduced or reused in any way without the express written permission of Alamance Consulting Engineers, P.A.

Alamance Consulting Engineers, P.A.

Consulting Engineers

200 N. Main St., Suite B Graham, N.C. 27253 Phone: (336) 226-4117 Fax: (336) 570-1926

TENANT UPFIT FOR:

COLORADO CAFE


Gibsonville, North Carolina

DRAWING NAME
PIPING
PLAN


DRAWN
MKB
CHECKED
SOLUTION
DATE
6/26/08

DATE
6/26/08
SCALE
AS NOTED
JOB NO.
7147
SHEET

**P-**2

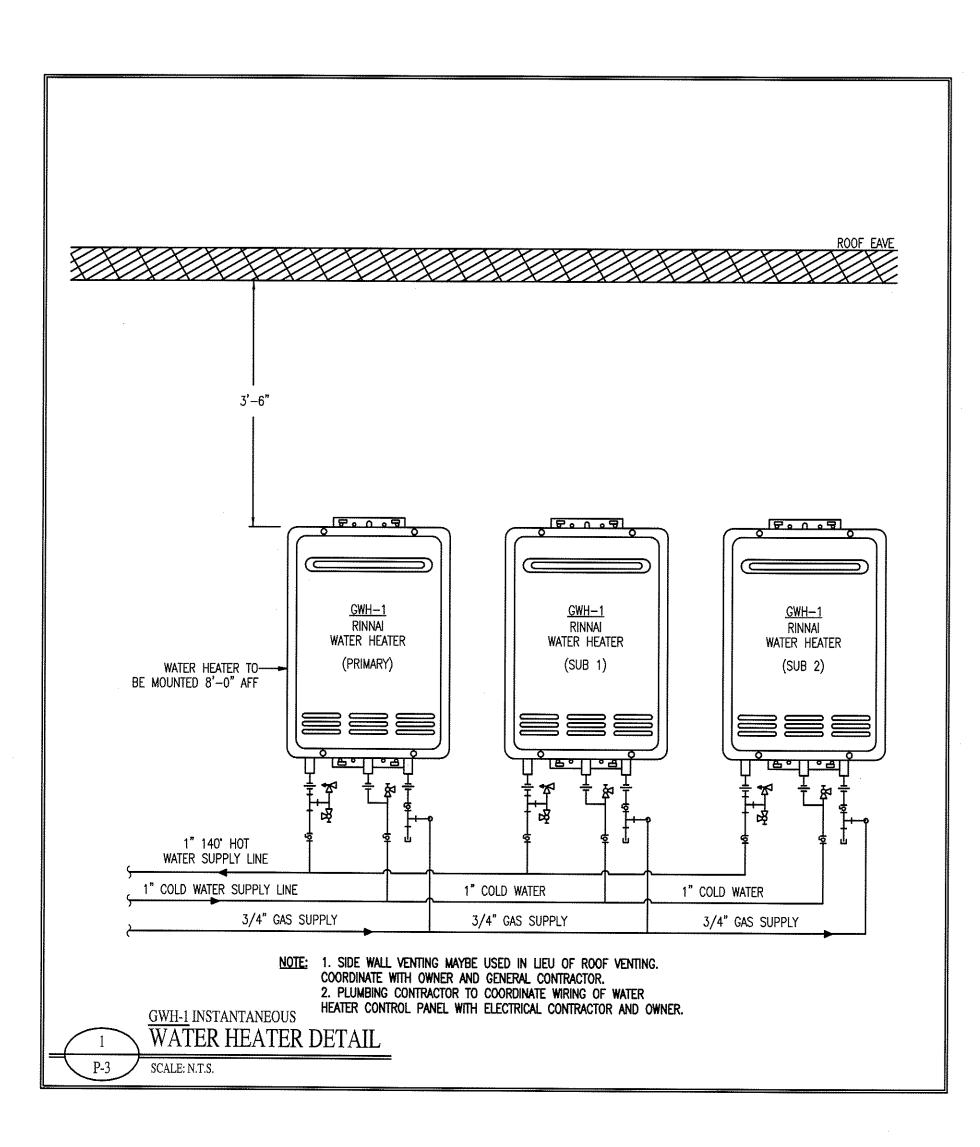

		G	AS WA	TER H	HEATE	R SCH	EDULE	
MARK	TANK VOLUME	RECOVERY	TEMPERATURE RISE	GAS INPUT	MIN. EFF	POWER	MANUFACTURER	MODEL
<u>GWH-1</u>		180 GPH	100	199 MBH	82%	120V/1ø	RINNAI	C85E (2532W-C)

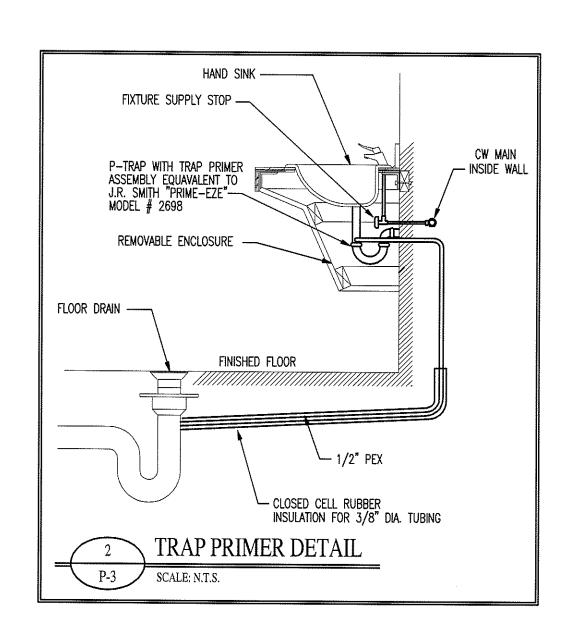

## PLUMBING NOTES:

- 1. PLUMBING TO BE INSTALLED IN ACCORDANCE WITH ALL STATE AND LOCAL CODES.
- 2. PLUMBING CONTRACTOR TO COORDINATE ALL WORK WITH OTHER TRADES.
- 3. ALL WASTE AND VENT PIPING TO BE SCHEDULE 40 P.V.C.
- 4. WATER LINES TO BE CROSS-LINKED POLYETHYLENE.
- 5. ALL P.V.C. UNDER SLAB SHALL BE A MINIMUM OF 2" NPS.
- 6. COPPER PIPING TO BE INSULATED WHERE IT PASSES THROUGH CONCRETE.
- 7. BACKFLOW PREVENTER ASSEMBLY (BFPA) TO BE 1-1/2" DOUBLE-CHECK TYPE, BFPA TO BE MOUNTED 12" A.F.F. AND 6" OF CLEARANCE ON EACH END AND MEET MANUFACTURERS RECOMMENDED ACCESS REQUIREMENTS.

8. PLUMBING CONTRACTOR SHALL (OR HAVE LOCAL MUNICIPALITY) PERFORM A WATER PRESSURE TEST. IF RESIDUAL WATER PRESSURE IS MORE THAN 60 PSI OR LESS THAN 35 PSI, CONTACT ENGINEER TO ASSESS NEED FOR A PRESSURE REDUCING VALVE (PRV) OR A PRESSURE BOOSTER SYSTEM.

9. INSULATE HOT & COLD WATER LINES IN ACCORDANCE WITH BUILDING CODE. INSULATE COLD WATER LINES WHERE SWEATING WOULD RESULT IN STRUCTURAL DAMAGE TO BUILDING DUE TO ROTTING OF WOOD OR STAINING OF CEILING

- 10. LAVATORIES ARE TO BE EQUIPPED WITH CLEAN—OUT TEES BELOW.
- 11. ALL FIXTURES ARE TO BE EQUIPPED WITH SHUT-OFF VALVES ON SUPPLY LINES.
- 12. INSTALL TEMPERING VALVE AND ADJUST HOT WATER TEMPERATURE TO 110°F.

13. THE CONTRACTOR SHALL COORDINATE THE LOCATION OF ALL PIPING AND EQUIPMENT WITH ALL OTHER TRADES PRIOR TO BEGINNING INSTALLATION TO AVOID CONFLICTS AND INTERFERENCE WITH OTHER TRADES.

14. FINAL UTILITY CONNECTIONS (GAS, ELECTRIC, WATER ETC.) TO EQUIPMENT SHALL BE MADE BY THE CONTRACTOR INSTALLING THE EQUIPMENT REQUIRING THE UTILITIES.

15. PLANS AND ISOMETRICS ARE DIAGRAMMATIC. THERE IS NO INTENT TO INDICATE ALL AND FITTINGS REQUIRED. GENERALLY, PIPING SHALL BE INSTALLED PARALLEL OR PERPENDICULAR TO AND PLUMB WITH WALL CONSTRUCTION.

16. SOIL AND WASTE PIPING SHALL BE LAID ON MINIMUM 1/4" PER FT. SLOPE FOR PIPE SIZES LESS THAN 3", AND MINIMUM 1/8" PER FT. FOR PIPE 3" AND LARGER UNLESS OTHERWISE NOTED.

17. UNLESS OTHERWISE NOTED, PLUMBING CONTRACT SHALL TERMINATE AT A POINT FIVE (5) FEET OUTSIDE THE BUILDING. FOR WORK BY OTHER CONTRACTORS OUTSIDE THE 5 FOOT TERMINATION, REFER TO SITE UTILITY DRAWINGS.

18. VALVES AND DEVICES INSIDE CHASES OR WALLS OR ABOVE NON-ACCESIBLE CEILINGS SHALL BE PROVIDED WITH APPROPRIATELY SIZED ACCESS PANEL COMPATIBLE WITH SURROUNDING FINISHES. SUCH ACCESS PANELS SHALL BE FURNISHED BY THE PLUMBING CONTRACTOR FOR INSTALLATION BY THE GENERAL CONTRACTOR.

19. PLUMBING VENT PIPING PENETRATING ROOF SHALL BE INSTALLED BY THE PLUMBING CONTRACTOR. CUTTING OF HOLES AND FLASHING OF PENETRATIONS SHALL BE BY THE GENERAL CONTRACTOR.

20. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONED LOCATIONS OF WALLS AND PARTITIONS AND FOR PARTITION THICKNESS AND CONSTRUCTION MATERIALS.

				PLUMBIN	G FI	XTUR	E SCH	HEDUL	E	
ITEM NO.	KITCHEN EQUIPMENT	* MODEL NO.			NNECTION S			REMARKS		
	ITEM NO.				C.W.	110° H.W.	140° H.W.	WASTE	VENT	NEW/INO
<u>WC-1</u>		WATER CLOSET — TANK TYPE	AMER. STD.	2998.012	1/2"			4"	2"	FLOOR MTD. 1.6 GAL/FLUSH, H.C. HEIGHT
<u>WC−2</u>	<del></del>	WATER CLOSET — TANK TYPE	AMER. STD.	2898.012	1/2"			4"	2"	FLOOR MTD. 1.6 GAL/FLUSH, STANDARD HEIGHT
<u>UR-1</u>		URINAL	KOHLER	K-4917				2"	2"	WATERLESS URINAL
<u>LV-1</u>		COUNTER MOUNT LAVATORY	AMER. STD.	1475.020	1/2"	1/2"		1-1/2"	1-1/2"	SINGLE LEVER FAUCET, TRUEBRO PIPING COVERS
<u>HS-1</u>	18	HAND SINK	ADVANCE TABCO	7-PS-79	1/2"	1/2"		1-1/2"	1-1/2"	SINGLE LEVER FAUCET, TRUEBRO PIPING COVERS
<u>FS-1</u>		FLOOR SINK	ZURN	Z-1902				3"	1-1/2"	10" DEEP, 12"x12" FLOOR RECEPTOR
<u>FD-1</u>		FLOOR DRAIN	ZURN	Z-415-B			<u></u>	3"	1-1/2"	BODY ASSEMBLY WITH "TYPE B" STRAINER AND TRAP PRIMER
<u>HD-1</u>		HUB DRAIN	CHARLOTTE PLASTICS	4"x2"				2"	1-1/2"	
<u>CW-1</u>	42	3'x3' CAN WASH			1/2"		1/2"	3"	1-1/2"	EXISTING, CONNECT TO SEWER & INSTALL WATER FIXTURE
<u>SK-1</u>	2	SINGLE COMPARTMENT SINK	WIN HOLT	WS1T2424LD24	1/2"		1/2"			
<u>SK-2</u>	24	SOIL DISHTABLE	ADVANCE TABCO	DTS-S60-60RX	1/2"		1/2"			
<u>DW</u>	26	DISHWASHER	PURITAN	PA-1			1/2"			
<u>SK-3</u>	29	THREE COMPARTMENT SINK	ADVANCE TABCO	T9-63-54-24RLX	3/4"		3/4"			
<u>SD-1</u>	37	SODA DISPENSER	<u></u>		1/2"					PEPSI
<u>CB-1</u>	22	COFFEE BREWER	BLOOMFIELD	8572	1/2"	<del></del>				
<u>IP</u>		TRAP PRIMER	J.R. SMITH	2698						SEE DETAIL 2/P-3

*	FIXTURE	MODEL	NUMBERS	LISTED	ARE	FOR	DESCRIPTION	ONLY.

		\	WASTE AN	D WATER	R CALCUL	ATIONS				
FIXTURE TYPE	OHANTITY	WASTE FIX	CTURE UNITS	HOT WATER	FIXTURE UNITS	COLD WATER	FIXTURE UNITS	TOTAL WATER FIXTURE UNITS		
	QUANTITY	PER UNIT	TOTAL	PER UNIT	TOTAL	PER UNIT	TOTAL	PER UNIT	TOTAL	
WATER CLOSET - TANK	3	4	12	0	0	5	15	5	15	
URINAL	1	4	4	0	0	5	5	5	5	
LAVATORY	2	1	2	1.5	3	1.5	3	2	4	
FLOOR DRAIN	5	2	10	0	0	0	0	0	0	
HUB DRAIN	2	1	2	0	0	0	0	0	0	
DISHWASHER (R)	1	2	2	1.4	1.4	0	0	1.4	1.4	
HAND SINK	2	2	4	1	2	1	2	1.4	2.8	
CAN WASH	1	2	2	2.25	2.25	2.25	2,25	3	3	
1 & 3-COMP SINK	3	4	12	3	9	3	9	4	12	
COFFEE BREWER	1	0	0	0	0	0.25	0.25	0.25	0.25	
SODA DISPENSER	1	0	0	0	0	0.25	0.25	0.25	0.25	
TOTAL			50		17.65		36.75		43.7	


1. 4" WASTE LINE SLOPED AT 1/8" PER 1'-0" IS ADEQUATE FOR 180 FIXTURE UNITS

2. 1-1/2" WATER LINE IS ADEQUATE FOR 56 GPM.

			-
GPI	ń	=	2

					MININ	MUN	FACIL	LITIES	S CAL	CULA	TIONS										
OCCUPANCY CLASSIFICATION (PER TABLE 403.1)	SQUARE FOOTAGE	SQ. FT. PER OCCUPANT (PER TABLE 1004.1.2)		DIVISION OF FACILITIES (PER 403.3)								FOUNTAINS	FIX IS WATER CLOSETS LAVATORIES				JRES PROV	IDED SHOWERS/	DRINKING	FOUNTAINS	
				MEN	WOMEN	MEN	WOMEN	MEN	WOMEN	T I	TUBS		ACCESSIBLE		WOMEN		MEN WOMEN	URINALS	TUBS		ACCESSIBLE
ITCHEN 101 (ASSEMBLY A-2)	760 (GROSS)	200 GROSS	4	2 (50%)	2 (50%)	_	_		_		_			_	_	_	_	-		_	
DINING 106 (ASSEMBLY A-2)	1,050 (GROSS)	15 NET	70	35 (50%)	35 (50%)		_		_	_		_	_	_	<u> </u>	<del>-</del>	_	_	<u></u>	_	_
TOTAL	1,810 (GROSS)		74	37 (50%)	37 (50%)	2	2	2	2	_		_	_	1	2	1	1	1		_	

Copyright © 2008 Alomance Consulting Engineers, P.A. All Rights Reserved No part of these plans may be copied, reproduced or reused in any way without the express written permission of Alamance Consulting Engineers, P.A.



200 N. Main St., Suite B Graham, N.C. 27253 Phone: (336) 226-4117 Fax: (336) 570-1926

DRAWING NAME PLUMBING NOTES AND DETAILS

CHECKED 6/26/08 AS NOTED

7147